


NOTES:

1. 6-INCH TAPPING SLEEVE AND VALVE IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 122.
2. THRUST BLOCKS ARE TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAILS 132A AND 132B.
3. WATER METERS ARE TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 801.
4. FIRE HYDRANT IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAILS 814 AND 816.
5. END OF LINE IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 813.
6. WATER SAMPLING STATION IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 826.

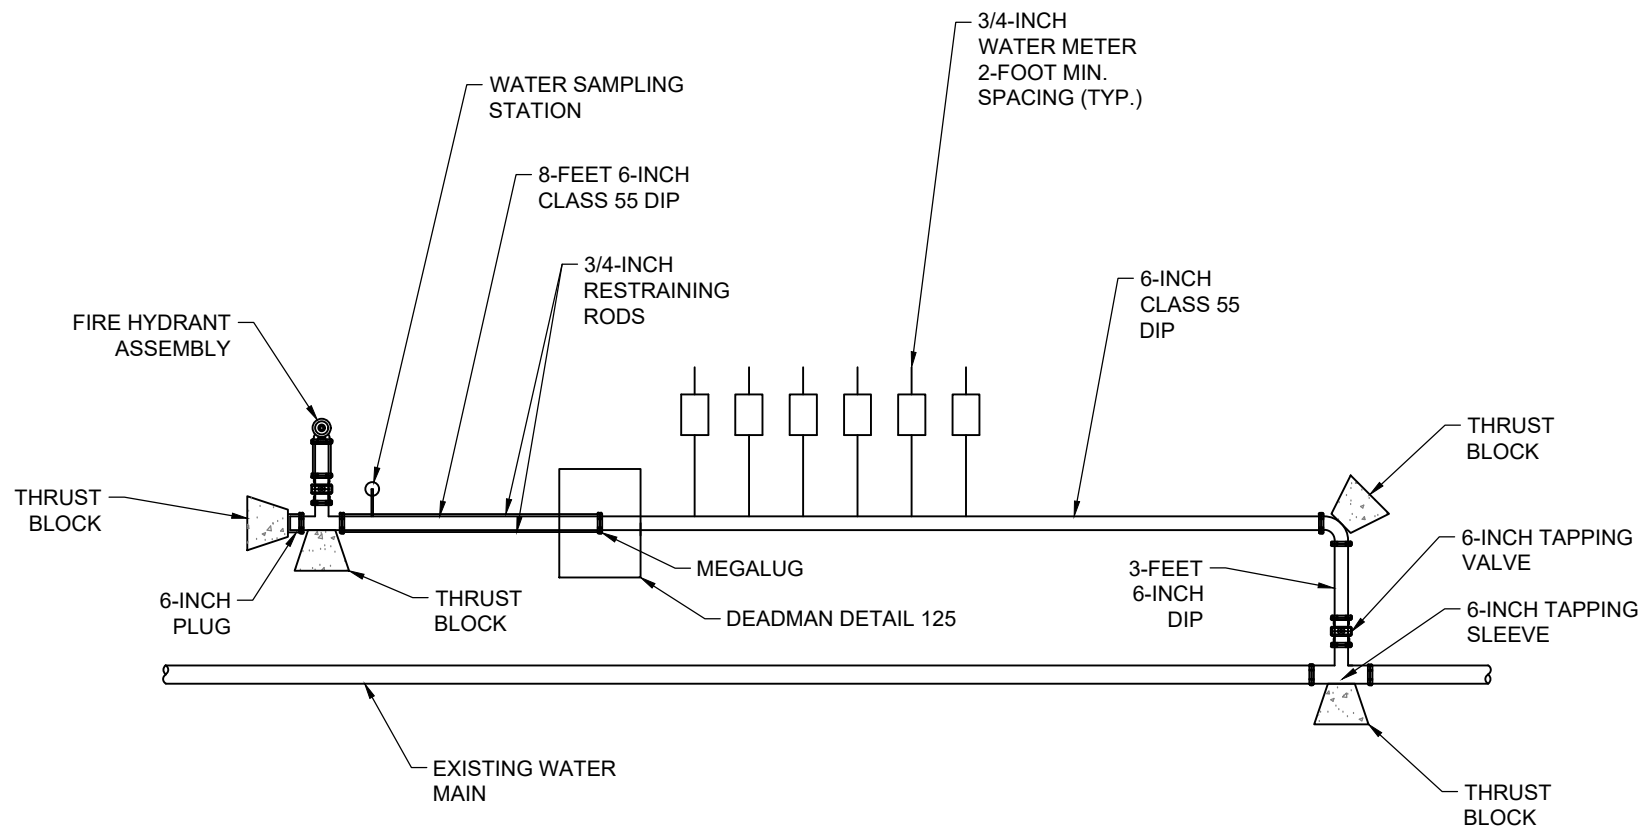

PLAN
N.T.S.

95% SUBMITTAL

FULTON COUNTY STANDARD DETAIL 827

WATER METER MANIFOLD DETAIL
FOR TOWNHOME DEVELOPMENTS

DATE	REVISIONS	DATE	REVISIONS
M/Y	XXX	M/Y	XXX

DGS/DRN/CHKD: XXX
 APPROVED: XXX
 DATE: XX-X-XX



FULTON COUNTY PUBLIC WORKS
 141 PRYOR ST. ATLANTA, GA. 30303
 404-612-7400 FAX: 404-224-0498

DRAWING NO.
827